




HEAT TRANSFER COOLERS

 Unit Coolers

 Air Cooled Condensers

 Brine / CO₂ Products

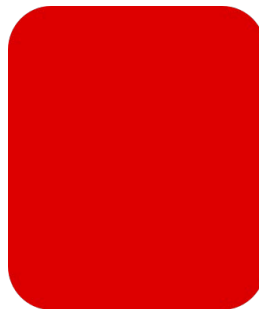


中科高易冷链系统（江苏）有限公司
CAS GYW COLD CHAIN SYSTEM (JIANGSU) CO., LTD.

The Products





All the fin coils of ZKGY refrigeration unit coolers,condensers and dry coolers are manufactured by the global leader of fin coil manufacturer: Modine manufacturing Inc. Together with other world class suppliers,ZKGY is becoming the top level brand of refrigeration heat exchanger OEM in China,providing our premium customers with the most professional energy saving,environmental friendly refrigeration heat exchanger solutions.

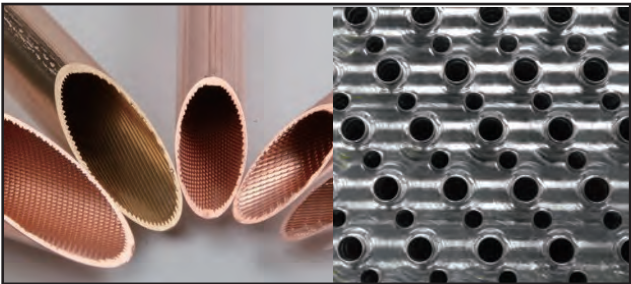


TL series of unit cooler adopts coils with 9.52mm inner grooved copper tube, staggered and sine wave Al fins. TM series of unit cooler adopts coils with 12.7mm inner grooved copper tube, staggered and corrugated Al fins.

All the supporting and end plate are made by Al Alloy, Unique floating tube design makes the coil leakage free and suitable for hot-gas defrost.

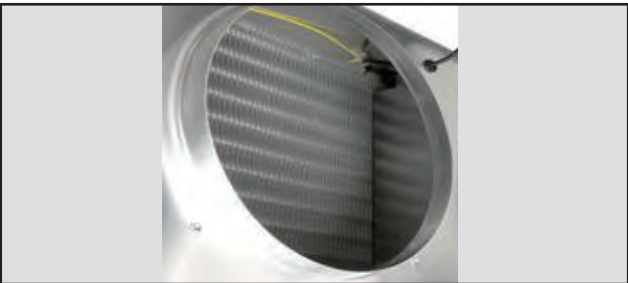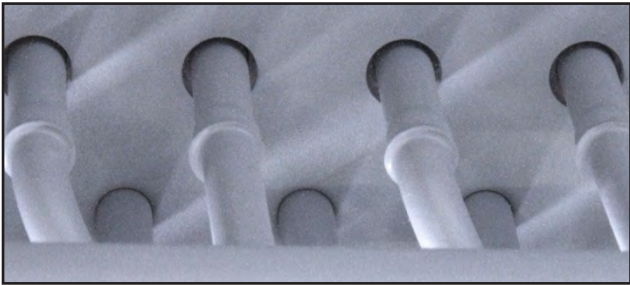

Middle panel to separate the fan motors are equipped as standard to avoid the possibility of "air leakage" and failure when one of the fan motors can not work.

High grade evaporative oil is utilized in fin punching process which can ensure an oil-free coil. Perfect tube expanding and fin collar process ensure the same heat transfer efficiency during the whole life cycle.

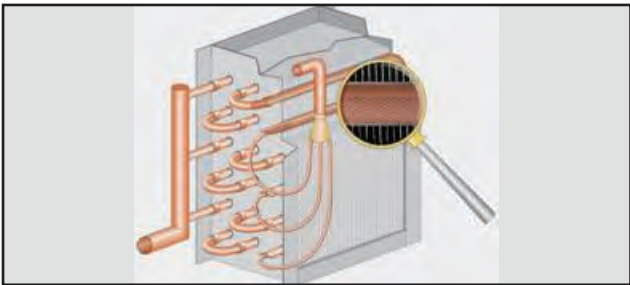


Specially designed drain system ensures a fast and rust free drainage of defrost.

The Products



High grade electrical panel for fan motors and heaters, indicating clearly the electrical connections.


Specially designed water defrost module, ensure an easy access to all the water parts and an accurate and even distribution of water.

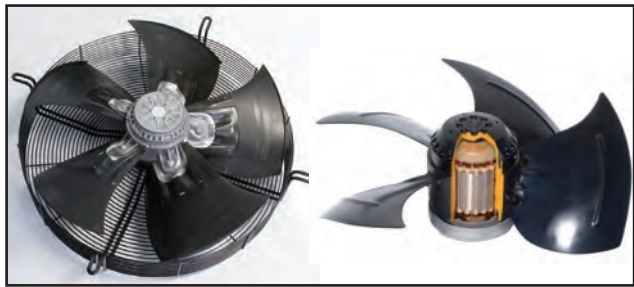

All the fan motors used are according to ZKGY newest testing and specifications. Only 5 diameters:

300mm、400mm、500mm、630mm、800mm external rotor axial fans are adopted.

Model identification

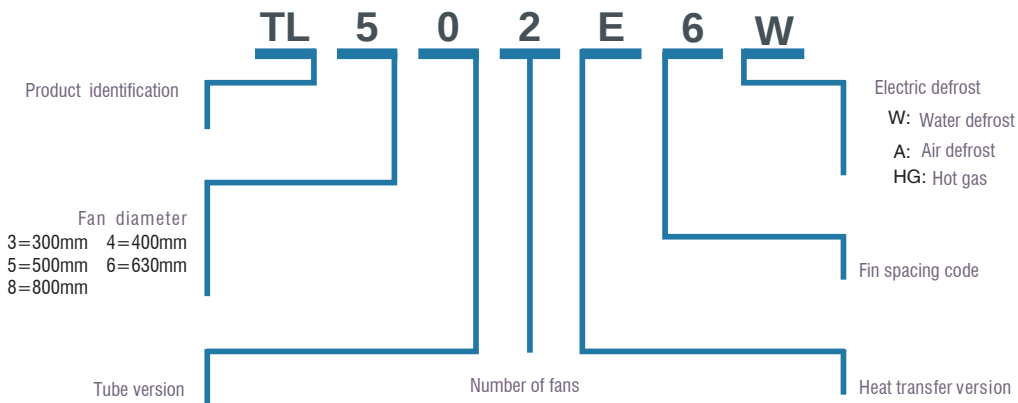

TL	Light Commercial Unit Cooler
TM	Heavy Duty Commercial Unit Cooler
TD	Dual Discharge Unit Cooler
TA	Angled Unit Cooler
TMB	Brine Unit Cooler
TLC	CO ₂ Unit Cooler
TMF/TFD/TML	Forced Air Chiller And Freezer
TVF	Agricultural Special Unit Cooler


Angled Unit Cooler

Fin Space 4mm	Models	TA311E4	TA311A4	TA312G4	TA312E4	TA312A4	TA313E4	TA313A4
SC1: Ta 10 °C Te 0 °C	kw	2.9	3.7	5.3	6.0	7.3	9.0	10.7
SC2: Ta 0 °C Te -8 °C	kw	2.0	2.6	3.6	4.2	5.1	6.3	7.4
Surface	m ²	8.1	12.2	11.9	16.2	24.3	24.3	36.5
Air Flow	m ³ /h	1115	970	2370	2230	1940	3345	2910

Fin Space 6.0mm	Models	TA311E6	TA311A6	TA312G6	TA312E6	TA312A6	TA313E6	TA313A6
SC2: Ta 0 °C Te -8 °C	kw	1.9	2.4	3.2	3.8	4.8	5.7	7.1
SC3: Ta -18 °C Te -25 °C	kw	1.3	1.8	2.4	2.6	3.4	4.0	4.9
Surface	m ²	5.4	8.1	8.2	10.8	16.2	16.2	24.3
Air Flow	m ³ /h	1260	1115	2730	2520	2230	3780	3345

Fan Mot. No.		1×300	1×300	2×300	2×300	2×300	3×300	3×300
Air Throw	m	5	4	6	6	5	7	6
Electric System V/PH/Hz		220/1/50	220/1/50	220/1/50	220/1/50	220/1/50	220/1/50	220/1/50
Fan Mot. Power W		1x85	1x85	2x85	2x85	2x85	3x85	3x85
Electric Defrost W		1500	1500	2700	2700	2700	4200	4200
Circuit Vol.	dm ³	1.8	2.7	2.7	3.6	5.4	5.4	8.1
Net Weight	kg	21	22	33	35	37	49	52
In Tube	mm	12	12	12	12	12	12	12
Out Tube	mm	16	16	16	22	22	28	28
Drain Connector Ø(GAS)		1	1	1	1	1	1	1
Drawing No.		31	31	32	32	32	33	33

300mm Fan

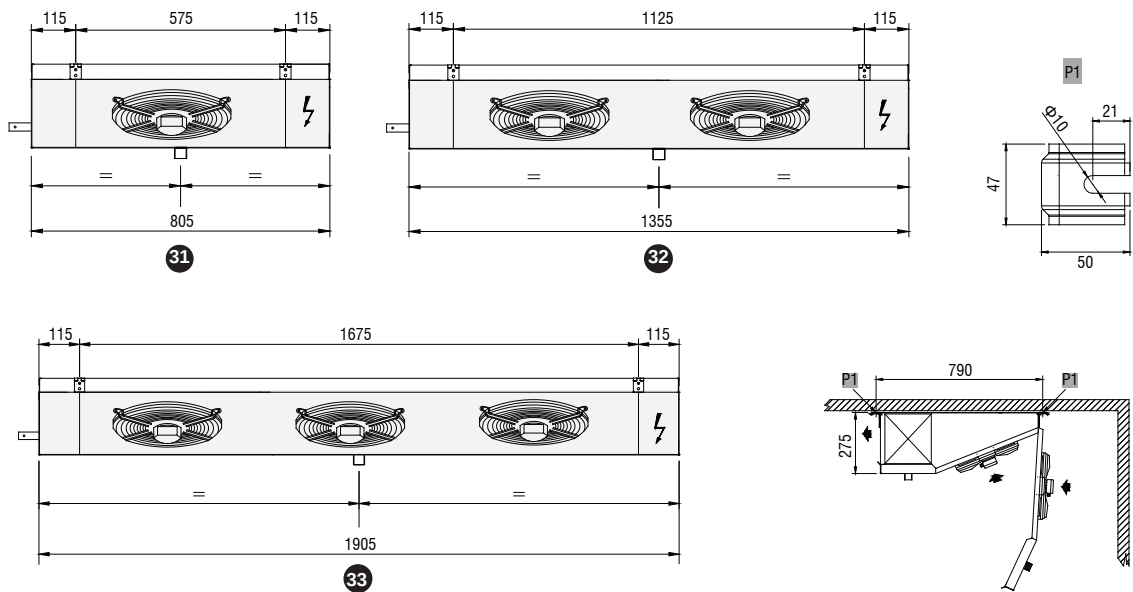

Unit Cooler Capacity Correction Factor



Refrigerant Type Factor

Refrigerant types	R134a	R22	R507A	R404A
Refrigerant factor	0.93	0.97	1	1

Correction factor SC1

Evaporation temperature °C	-8	-6	-4	-2	0	2	4	6	8	12
TL0 Correction factor	0.86	0.89	0.93	0.96	1.00	1.04	1.08	1.12	1.16	1.20
TM1 Correction factor	0.88	0.91	0.94	0.97	1.00	1.03	1.07	1.11	1.15	1.19
Max. KTD	10	10	10	10	10	10	10	10	10	10
Min. KTD	4	4	4	4	5	5	5	5	6	6

Correction factor SC2

Evaporation temperature °C	-14	-12	-10	-8	-6	-4	-2	0	2	4	6	8	12
TL0 Correction factor	0.88	0.92	0.96	1.00	1.04	1.08	1.12	1.17	1.22	1.26	1.31	1.36	1.40
TM1 Correction factor	0.93	0.95	0.97	1.00	1.03	1.07	1.10	1.14	1.17	1.21	1.25	1.28	1.35
Max. KTD	8	8	9	10	10	10	10	10	10	10	10	10	10
Min. KTD	4	4	4	4	4	4	4	5	5	5	5	6	6

Correction factor SC3

Evaporation temperature °C	-40	-36	-30	-25	-20	-15	-12
TL0 Correction factor	0.78	0.85	0.92	1.00	1.08	1.16	1.21
TM1 Correction factor	0.86	0.90	0.96	1.00	1.05	1.11	1.15
Max. KTD	8	8	10	10	10	10	11
Min. KTD	4	4	4	4	4	4	4

Correction factor SC4

Evaporation temperature °C	-47	-44	-40	-36	-31	-25	-20
TL0 Correction factor	0.70	0.76	0.84	0.91	1.00	1.08	1.15
TM1 Correction factor	0.82	0.86	0.91	0.95	1.00	1.05	1.11
Max. KTD	6	8	8	8	10	10	10
Min. KTD	4	4	4	4	4	4	4

Correction factor SC5

Evaporation temperature °C	-52	-50	-47	-44	-40	-36	-31	-25
TL0 Correction factor	0.75	0.81	0.87	0.93	1.00	1.09	1.18	1.28
TM1 Correction factor	0.83	0.85	0.90	0.94	1.00	1.05	1.10	1.16
Max. KTD	6	6	6	7	8	8	10	10
Min. KTD	4	4	4	4	4	4	4	4

STD conditions in compliance to EN328 standard

Operating mode	SC1	SC2	SC3	SC4	SC5
Evap. temperature	0 °C	-8 °C	-25 °C	-31 °C	-40 °C
Temperature difference	10K	8K	7K	6K	6K
Air inlet temperature	10 °C	0 °C	-18 °C	-25 °C	-34 °C
Superheat	6.5 K	5.2 K	4.6 K	3.9 K	3.9 K
Relative humidity	85 %	85 %	95 %	95 %	95 %
Wet conditions factor	1.35	1.15	1.05	1.01	1

Air Cooled Condensers Capacity Correction Factor

F1 - Temperature Difference factor

Heat transfer temperature difference K	6	7	8	9	10	11	12	13	14	15
Normal refrigerant $F1 = \Delta t / 15$	0.4	0.47	0.53	0.6	0.67	0.73	0.8	0.87	0.93	1
R407C and other refrigerants with high glide	0.32	0.39	0.46	0.54	0.62	0.69	0.77	0.85	0.93	1

F2 - Refrigerant type factor

Refrigerant types	R407A	R407C	R134a	R22	R507A	R404A
Refrigerant factor	0.83	0.87	0.93	0.96	1	1

F3 - Ambient temperature factor

Ambient temperature °C	15	20	25	30	35	40	45
Ambient temperature factor	1.03	1.02	1	0.99	0.975	0.96	0.95

F4 - Altitude factor

Altitude m	0	500	1000	1500	2000	2500
Altitude factor	1	0.96	0.93	0.89	0.85	0.8

F5 - Fin Material factor

Fin Material	Aluminum	Hydrophilic aluminum	Polyester coated aluminium	copper
Fin Material factor	1.03	1.02	1	1.06

Selection Formula:

$$\text{Required capacity} = \text{Compressor Heat Rejection} \div F1 \div F2 \div F3 \div F4 \div F5$$

Examples

Compressor heat rejection * (4HE-18) 27 kW

* Based on $T_e -25^\circ\text{C}$, $T_c 45^\circ\text{C}$, Suction gas superheat 10K, Liq. subc. Liquid subc. 2K

F1 – Temperature difference factor	(8K)	0.53
F2 – Refrigerant factor (R22)		0.96
F3 – Ambient temperature Factor	(35°C)	0.975
F4 – Altitude factor	(0m)	1
F5 – Fin material factor	(Coated aluminum)	1

计算 Result

$$\text{Required capacity} = 27 \div 0.53 \div 0.96 \div 0.975 \div 1 \div 1 = 54.4 \text{ KW}$$

Model selected : MH502D (56.2kW) or MH504A (60.1kW)



The company is committed to unremittingly improving product quality and design, to provide customers with the highest quality products, so our company retains modified samples.

Technical parameters in this book without prior notice. No enterprise or individual shall copy the samples in this sample without the permission of our company. Content, hereby declare.

Add: Dailuo Rd. Wujin District, Changzhou, Jiangsu, China

Tel : (+86) 51981169986

Mob: (+86) 13806118729

Web: www.coldroomsuppliers.com

